



Insulations
by ETA



Insulation selection aid

Approved construction types of cable and combination insulation


Just a few steps to the right OBO insulation system

This selection aid provides you with an overview of the different cable and combination insulation types from the OBO portfolio and supports you in finding the right system for your applications.

Observe ETAs and mounting instructions

The respective ETAs and mounting instructions must be observed for each system. They contain information on the assignment, the passed-through elements and spacing rules, which are to be complied with when installing the insulation.

The most common cable types

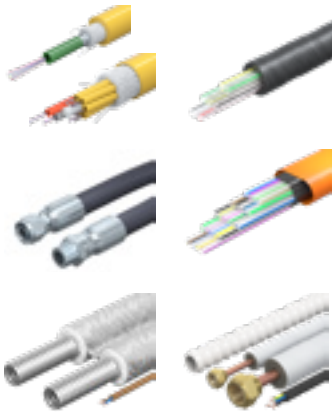

The table of the passed-through elements on the following pages is not exclusive and is intended to offer an initial idea of the most common cable types. Additional cable types can be specified in ETAs and mounting instructions.

- Hydraulic lines
- Beverage hoses
- Hollow conductor/coaxial cable
- Cable protection pipes for fibre-optic conductors
- Combinations of pipes and accompanying cables for air-conditioning systems
- Solar thermal lines/double solar pipes

Further information on this subject can be found in the ETAs and mounting instructions.



OBO imparts knowledge

For more information and training on our insulation systems, we offer webinars and on-spot seminars, either at your premises or at our campus at our headquarters in Menden.

OBO Academy: From the basic principle through to the concrete application

For many years, the OBO Academy has offered a comprehensive portfolio of seminars. "Advantage through knowledge" is not just a slogan here, but a promise: With first-hand information, a link to practical situations and expert knowledge, we can offer participants a decisive knowledge advantage. In our seminars, planner days or online seminars, we will bring you up to speed with current developments, trends, standards and regulations.



Key parameters for the installation of insulation systems

Here, you can find an overview of the relevant parameters for the installation of insulation systems.

Component strength
How thick is the wall or the ceiling?

Insulation thickness
How thick must the installed insulation be to achieve the required fire resistance class?

Insulation size
How large may the area of the insulation system be?

Maximum approved area of an insulation system

The maximum approved area of an insulation system can be determined at a glance using the following pictograms:



Large
1 m² or more



Medium
0.25 m² to 1 m²



Small
Up to 0.25 m²

Please note: The appropriate ETAs and mounting instructions regulate the approved dimensions (width x height), so that the area data represents just rough guide values!


Applicability of the passed-through elements

The applicability of one of the passed-through elements (cable, electrical installation pipe, metal pipe, etc.) can be determined using the following pictograms:

- ✓ Approved: The selected element can be passed through insulation.
- + Approved with additional measures: The selected element can be run through the insulation, but must be combined with additional products (pipe sleeve, section insulation made of mineral wool, cable coil, etc.)
Further information can be found in the ETAs and mounting instructions
- ✗ Not permitted: The element may not be passed through!

OBO Construct: Planning fire insulation has never been simpler!

OBO Construct is a collection of a powerful planning modules, which were developed especially for electrical installation engineers and planners. The tool offers support for product configuration and offers a selection aid for matching systems. The OBO Construct module for fire insulation guides users to the matching insulation system via just a few questions. An additional documentation function means proof can be obtained with just a few clicks that the insulation was created correctly and in a manner conforming to the approval. Photos of labelling panels and fire protection approvals can be uploaded very easily. This allows OBO Construct to create flawless documentation and allows easy acceptance at the end of construction!

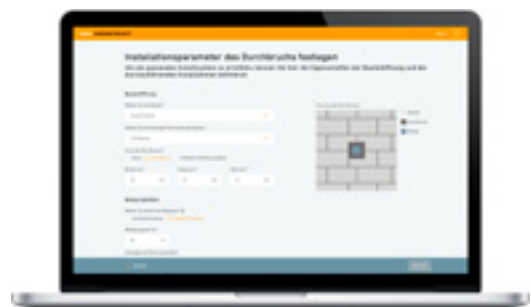



system	PYROMIX®	PYROPLATE® Fibre	PYROBAG®
View			
Insulation type	Mortar insulation	Soft insulation	Cushion insulation
Approval	ETA-17/0472	ETA-17/0364	ETA-18/1069
Construction type	Combination insulation	Combination insulation	Cable insulation

Installation locations	Solid walls		Solid ceilings		Lightweight partitions	
Max. insulation size*	≥ 2 m ²	≥ 2 m ²	≥ 2 m ²	≥ 2 m ²	≥ 2 m ²	approx. 1 m ²
Insulation thickness	150 mm	150 mm	150 mm	150 mm (2 layers) 240 mm (4 layers)	120 mm (2 layers only)	350 mm
Min. component strength	150 mm	150 mm	150 mm	150 mm (2 layers) 200 mm (4 layers)	100 mm (2 layers only)	125 mm
Fire resistance class up to 90 minutes	EI120 150 mm thickness EI240 240 mm thickness	EI120 Two layers EI240 Four layers	EI120 150 mm thickness EI240 240 mm thickness	EI120 Two layers EI240 Four layers	EI120 Two layers	EI90
Permitted installations		Cable				
		Cable bundle				
		Plastic conduit, rigid				
		Plastic conduit, flexible				
		Bundle of plastic conduit				
		Steel conduit				
		Cable support systems				
		Metal pipes with section insulation				
	Plastic pipes (for heating and sanitary)					

PYROSIT® NG	PYROPLUG® MagicBox	PYROPLUG® Block	PYROPLUG® Peg
			
Fire protection foam	Fire protection box	Foam block	Foam plug
ETA-11/0527	ETA-22/0175	ETA-15/0803	ETA-15/0701
Combination insulation	Combination insulation	Combination insulation	Cable insulation
approx. 0.25 m ² 	approx. 0.25 m ² as group 	approx. 0,6 m ² 	Ø 25 cm 
200 mm	300 mm	200 mm	≥ 170 mm
100 mm	100 mm	100 mm	100 mm
EI90	EI90	EI120	EI120
approx. 0.2 m ² 	approx. 0.25 m ² as group 	≥ 2 m ² 	Ø 25 cm 
200 mm	300 mm	200 mm	≥ 170 mm
150 mm	150 mm	150 mm	150 mm
EI90	EI90	EI120	EI120
approx. 0.25 m ² 	approx. 0.25 m ² as group 	approx. 0.6 m ² 	Ø 25 cm 
200 mm	300 mm	200 mm	≥ 170 mm
94 mm	94 mm	94 mm	100 mm
EI90	EI90	EI120	EI120
✓	✓	✓	✓
✓	✓	✓	✓
✓	✓	✓	✓
✓	✓	✓	✗
✓	✓	✓	✗
✓	✓	✓	✓
✓	✓	✓	✓
✓	+	✓	✗
+	+	✓	✗



system	PYROCOMB® Intube	PYROCOMB® Intube HP	PYROCOMB® Tubes
View			
Insulation type	Pipe shells	Pipe shells	Pipe sleeves
Approval	ETA-13/0904	ETA-13/0904	ETA-12/0207
Construction type	Cable insulation	Cable insulation	Cable insulation

Installation locations	Solid walls		Solid ceilings		Lightweight partitions				
		Max. insulation size*		approx. Ø 16 cm		approx. 0.01 m²		approx. Ø 16 cm	
		Insulation thickness		≥ 150 mm		200 mm		100 mm	
		Min. component strength		150 mm		150 mm		100 mm	
		Fire resistance class up to 90 minutes		EI120		EI120		EI120	
		Max. insulation size*		approx. Ø 16 cm				approx. Ø 16 cm	
		Insulation thickness		≥ 150 mm				150 mm	
		Min. component strength		≥ 125 mm				150 mm	
		Fire resistance class up to 90 minutes		EI120				EI120	
		Max. insulation size*		approx. Ø 16 cm		approx. 0.01 m²		approx. Ø 16 cm	
		Insulation thickness		≥ 150 mm		200 mm		94 mm	
		Min. component strength		100 mm		100 mm		94 mm	
	Fire resistance class up to 90 minutes		EI120		EI120		EI120		

Permitted installations	Cable		✓	✓	+
		Cable bundle	✓	✓	✗
		Plastic conduit, rigid	✗	✗	✗
		Plastic conduit, flexible	✓	✓	✓
		Bundle of plastic conduit	✓	✓	✓
		Steel conduit	✗	✗	✗
		Cable support systems	✗	✗	✗
		Metal pipes with section insulation	✗	✗	✗
		Plastic pipes (for heating and sanitary)	+	✗	✗

OBO Bettermann Holding GmbH & Co. KG

P.O. Box 1120
58694 Menden
GERMANY

Customer Service

Tel.: +49 23 73 89 - 17 00
export@obo.de

www.obo-bettermann.com

© OBO Bettermann 07/2024 EN

Building Connections

